


SEGMENT K-L, N-O



NOT TO SCALE

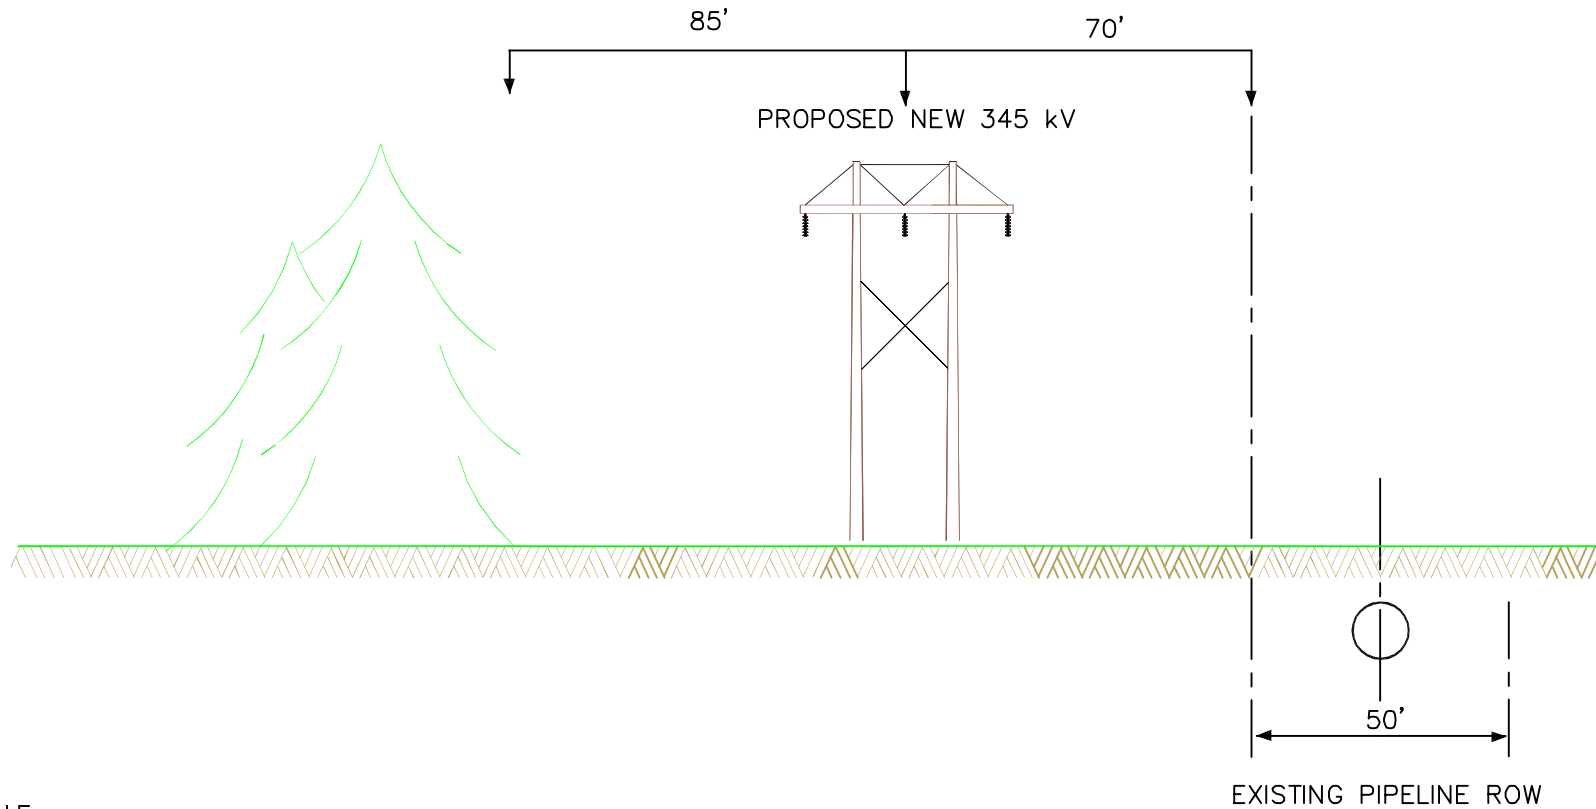

APPENDIX 1-3
TYPICAL ROW CONFIGURATION
ALONG EXISTING PIPELINE ROW
BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT